


**ELECTRICAL NOTES**

- ◇ 1" C.W. (2) AQC294 + (2) AQC294 + 2#12
- ◇ 1" C.W. (2) AQC294 + (2) AQC294 + 4#12
- ◇ 1" C.W. AQC294 + AQC294 + 2#12
- ◇ NEW CLASSROOM IDF HUBBELL RE4-U4 W/ PATCH PANEL + FIBER PATCH PANEL + UPS. SWITCH WILL BE F80. MOUNT HIGH ON WALL ADJACENT TO WIREMOLD.
- ◇ (N) 6 STRAND SINGLE MODE FIBER IN (E) CONDUIT.
- ◇ (N) (2) 6 STRAND, SINGLE MODE FIBER IN CONDUIT.
- ◇ (N) (4) 6 STRAND, SINGLE MODE.



EXISTING FIRE ALARM SITE PLAN

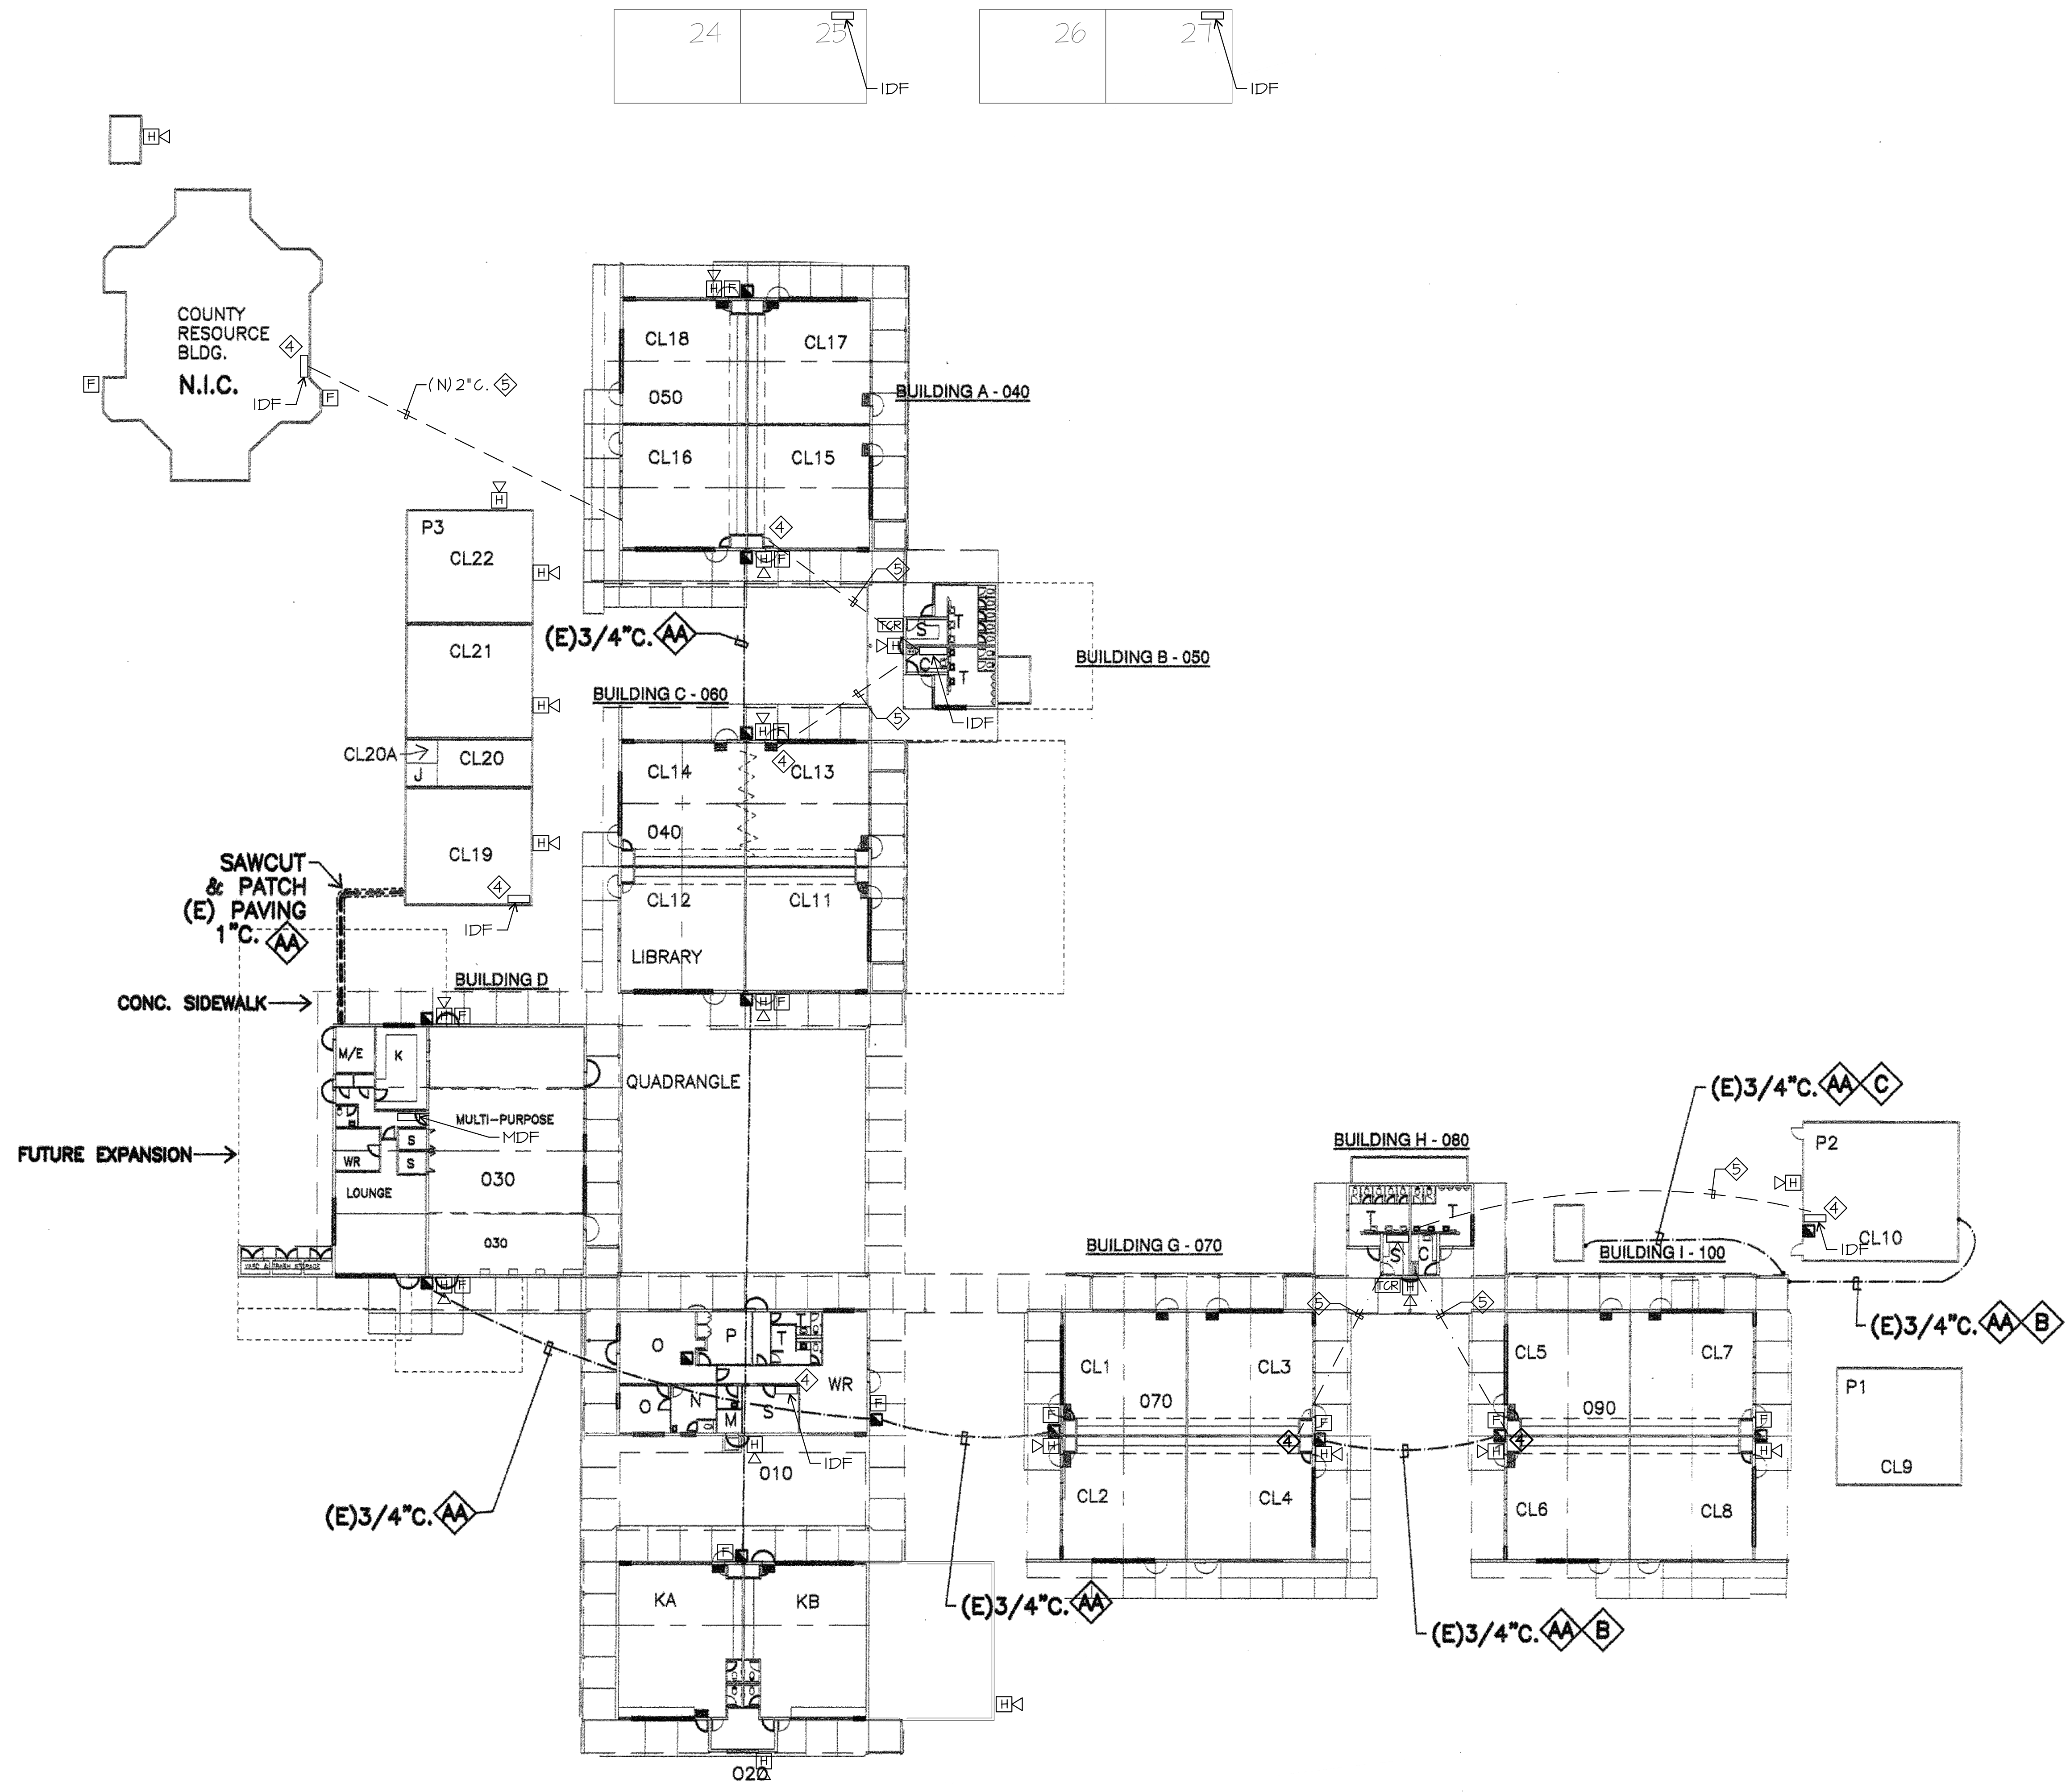

GOLETA UNION SCHOOL DISTRICT  
FIRE ALARM + INTERCOM SYSTEM UPGRADES  
GOLETA, CA.

HOLLISTER  
4950 ANITA LANE  
SANTA BARBARA, CA. 93111

EXISTING  
FIRE ALARM  
SITE PLAN

DATE	12-20-18
SCALE	A5 NOTED
DRAWN	MG/JR
JOB	17299
SHEET	FA-6
OF	SHEETS